X-330-202-M

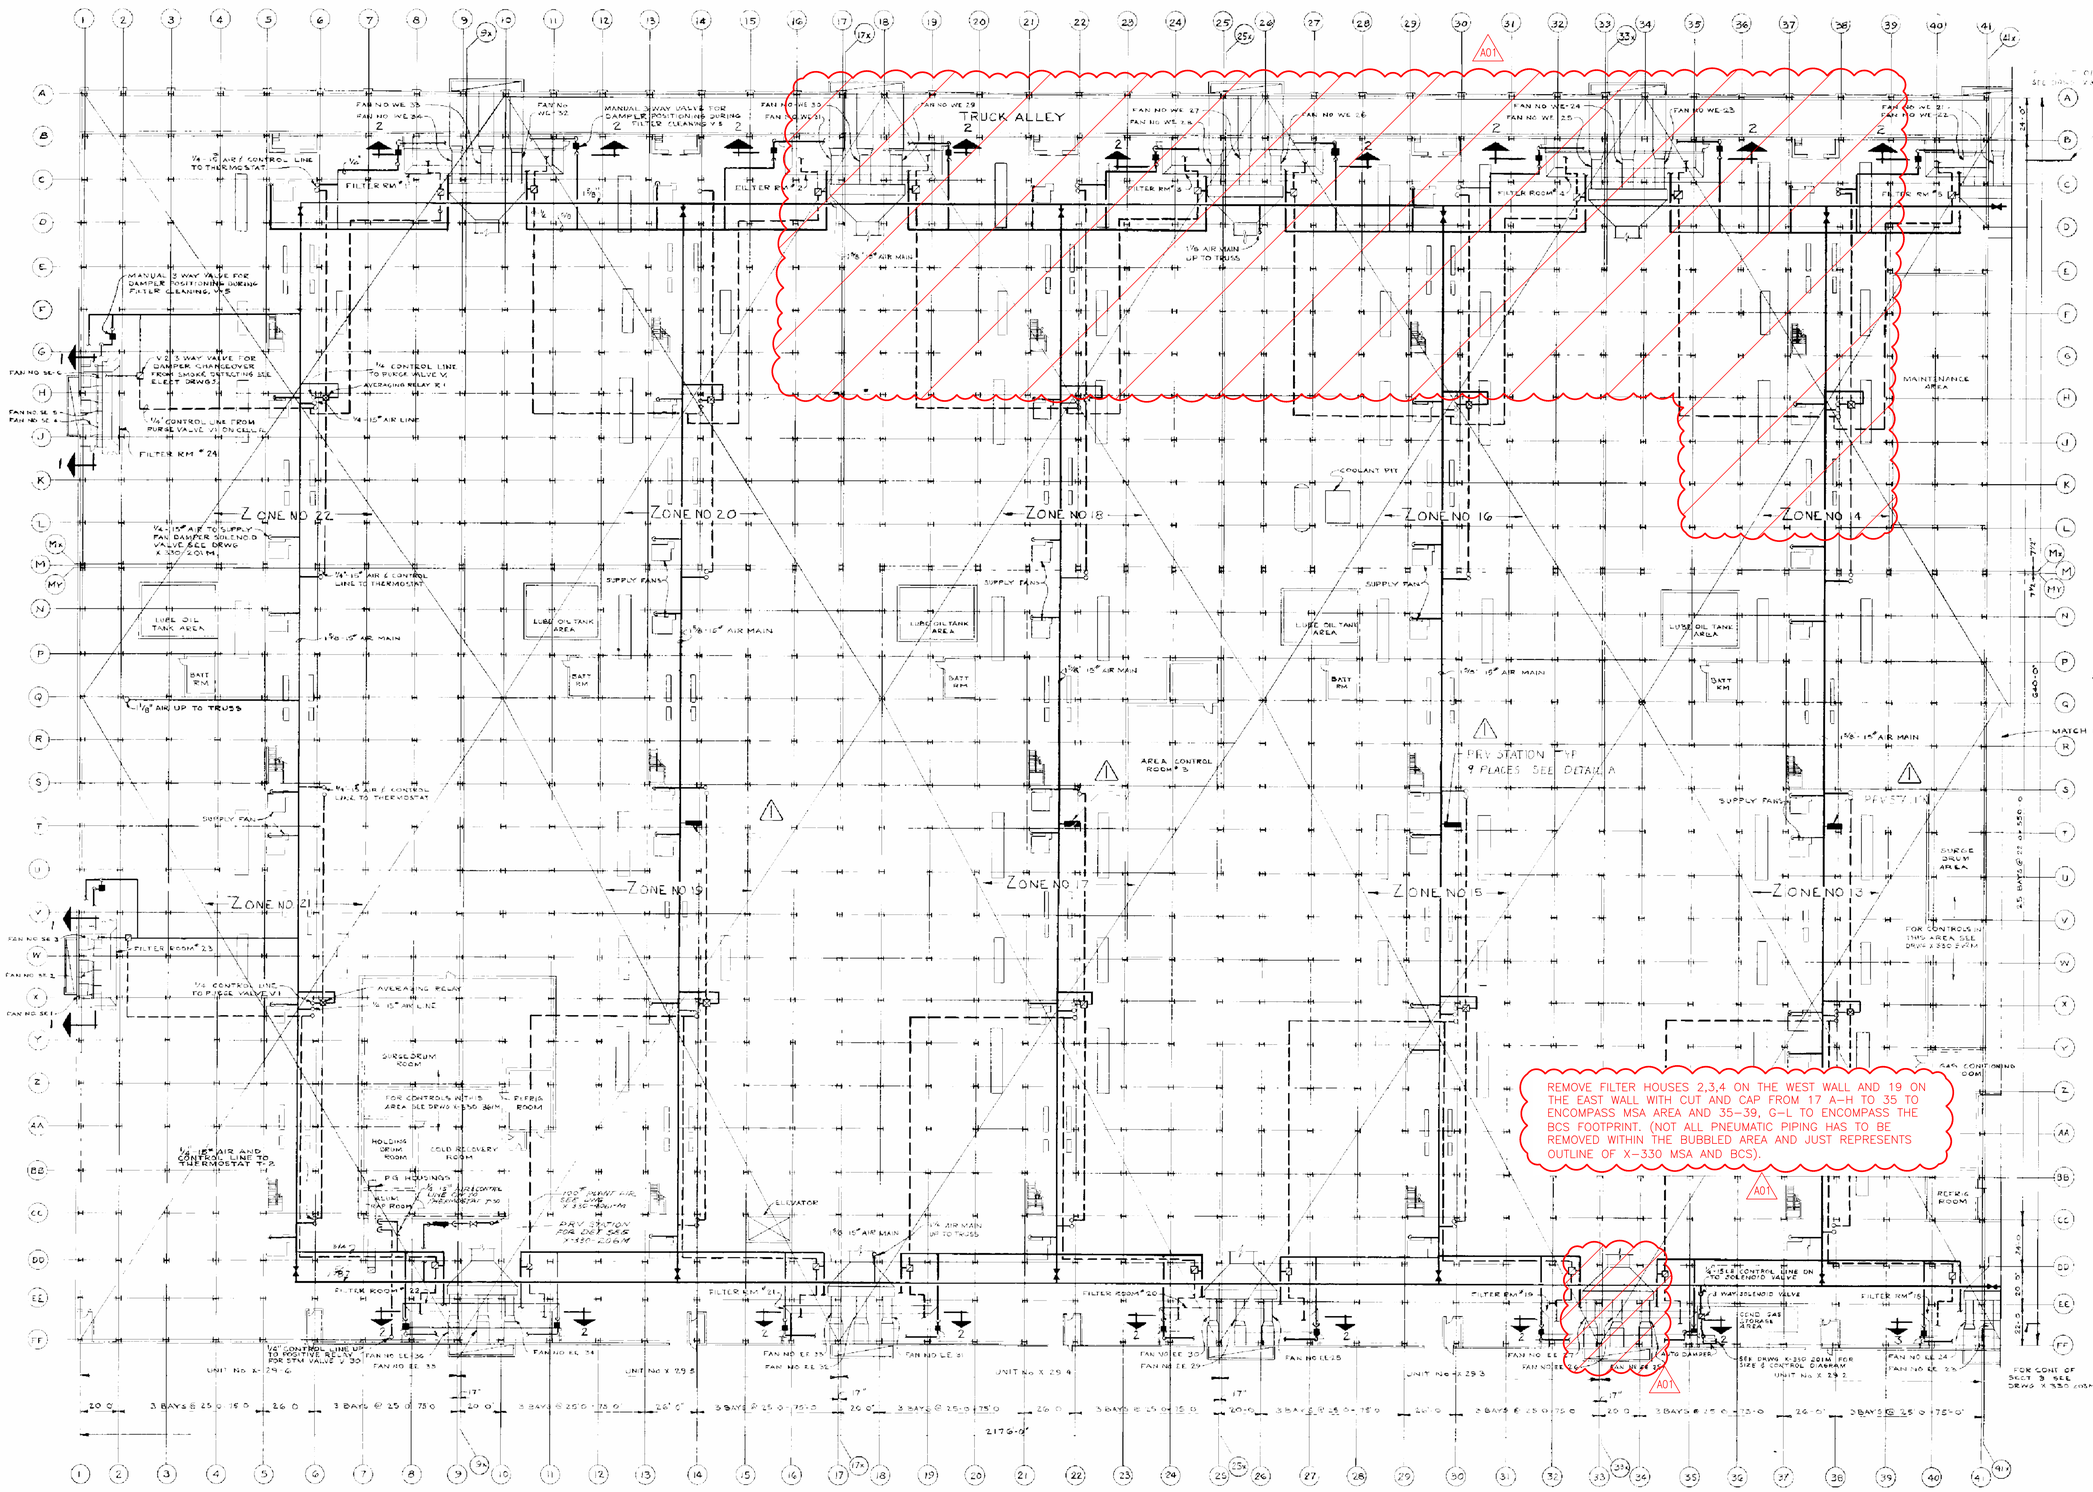

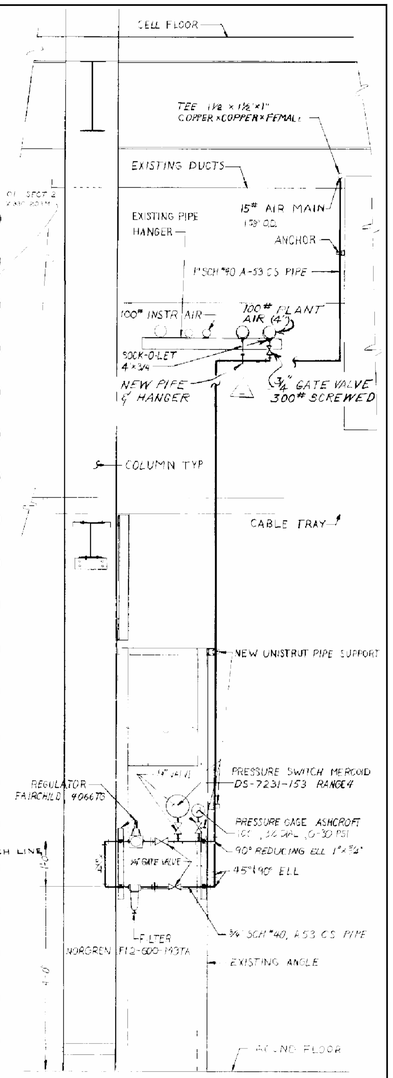

TYPICAL DETAIL "A"

SCALE: 3/4"= 1'-0"

PRV STATION AT COLUMNS T14, T-22, T-30, T-38, T-46, T-54, T-62, T-70, & T-78

NOTE:
ALL SCREWED FITTINGS FOR SCH.#40 PIPE SHALL BE MALLEABLE IRON 300# UNLESS OTHERWISE SPECIFIED.

BASE DOCUMENT: X-330-202-M, REV. 2 CAD OVERLAY

REV NO	DATE	ISSUED FOR	BY	APP DATE
A01	5/28/24	CFC PER ESO E6663-001	WKB	DAK

UNITED STATES
ATOMIC ENERGY COMMISSION

GIFFELS & VALLET, INC
ENGINEERS
DETROIT 26 MICHIGAN

DRAWING TITLE
AUTOMATIC CONTROLS
GROUND FLOOR - SOUTH HALF

DRAWING APPROVED — DATE	DRAWING APPROVED DATE	DRAWING APPROVED — DATE
C. J. Stieglitz 7-23-24 ENGINEER	R. A. WALKER 7-23-24 CARBIDE & CARBON CHEMICAL CO	L. H. JACKSON A.E.C. ENGINEER

DRAWN A. DOWNEY	DATE 10-11-72	CHECKED	DATE 6-27-24	JOB 51-1G5-X
IN CHARGE	DATE 7-13-73	SHEET	DATE 7/16/73	

PROJECT: PORTSMOUTH AREA | BUILDING: X-330-202-M | SHEET | REV: A01

LEGEND

AIR MAIN (15")
CONTROL LINE
AVERAGING RELAY R1
SMOKE DETECTION 3 WAY VALVE V2
FILTER ROOM SHUT OFF 3 WAY VALVE V5
SECTIONALIZING VALVE

GROUND FLOOR PLAN
SCALE 1/32"=1'-0"

NOTE
1 FOR LOCATION OF SECT. 1, 2 AND 3 SEE DRWG X 330-202-M AND X 330-203-M (SIMILAR REFERENCES)
2 FOR REFERENCE DRAWINGS SEE DRWGS X 330-203-M

"POOR QUALITY ORIGINAL"

This document has been reviewed and is UNCLASSIFIED and NOT UCNI. This review does not constitute clearance for public release.

CHAD EALEY (Affiliate) Digitally signed by CHAD EALEY (Affiliate) Date: 2025.05.12 11:09:01 -04'00' #192 DIG. SIGN.
Authorized Derivative Classifier Date

* DESIGN MANAGER: APPROVAL AND DATE:
WAYNE HACKER (Affiliate) Digitally signed by WAYNE HACKER (Affiliate) Date: 2025.07.17 16:19:22 -04'00'

SHEET NO	TITLE
	REFERENCE DRAWINGS